LITTLE COTTONWOOD DISTRIBUTION SYSTEM DIVERSIONS (5/25/2001)

1: Overflow at Murray Power Plant

2: Overflow at Murray Power Plant

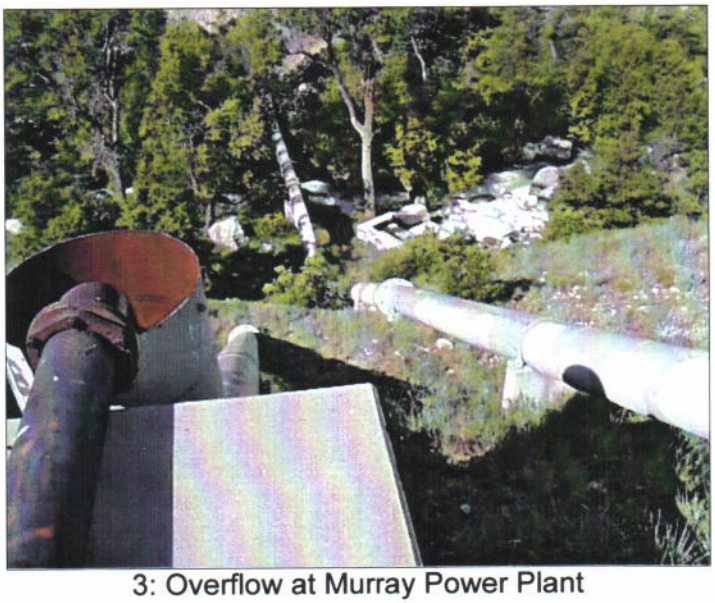

3: Overflow at Murray Power Plant

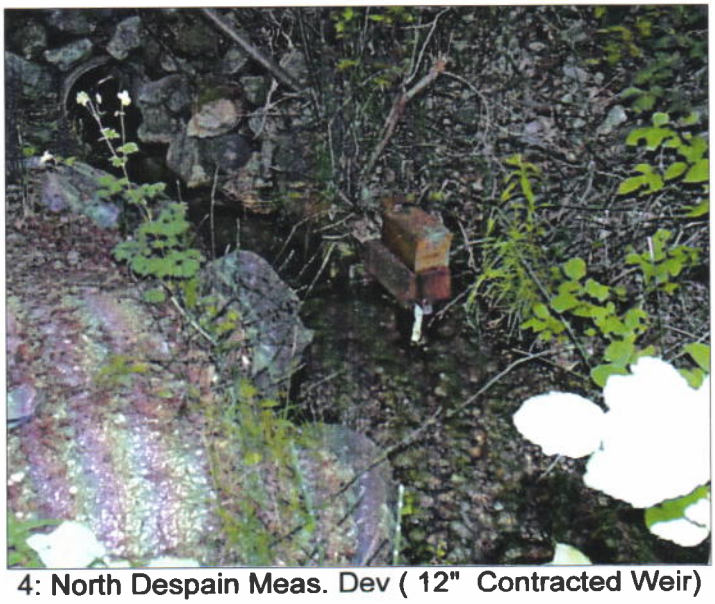

4: North Despain Meas. Dev (12" Contracted Weir)

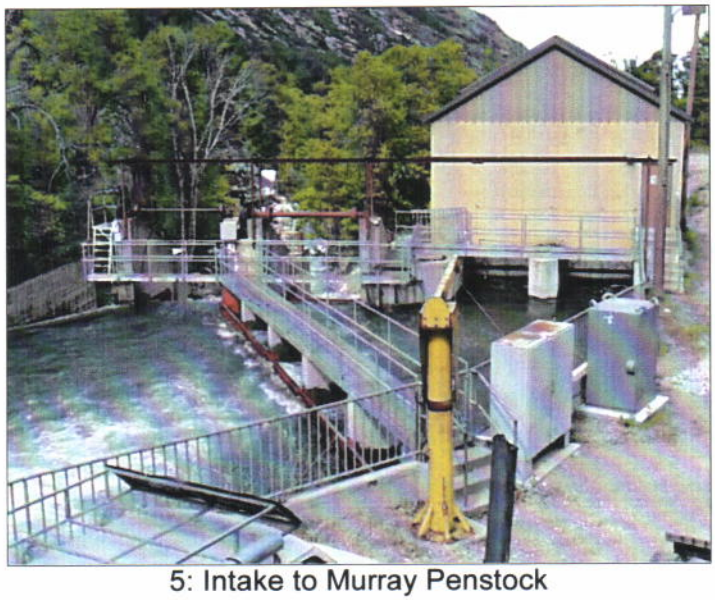

5: Intake to Murray Penstock

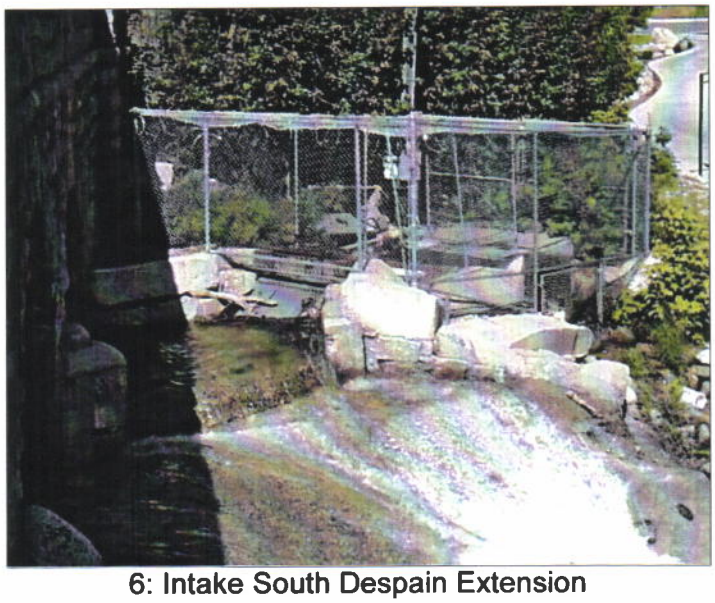

6: Intake South Despain Extension

LITTLE COTTONWOOD DISTRIBUTION SYSTEM DIVERSIONS (5/25/2001)

7: Sandy Well (Small)

8: So. Despain & Extension (4' Supress Weir)

9: Sandy Well (Big)

10: South Despain - 90 degree V Notch Weir

11: LaCaille - 4 ' Contracted Rectangular Weir

12: L Cottonwood Main Meas. Device (15' Flume)

LITTLE COTTONWOOD DISTRIBUTION SYSTEM DIVERSIONS (5/25/2001)

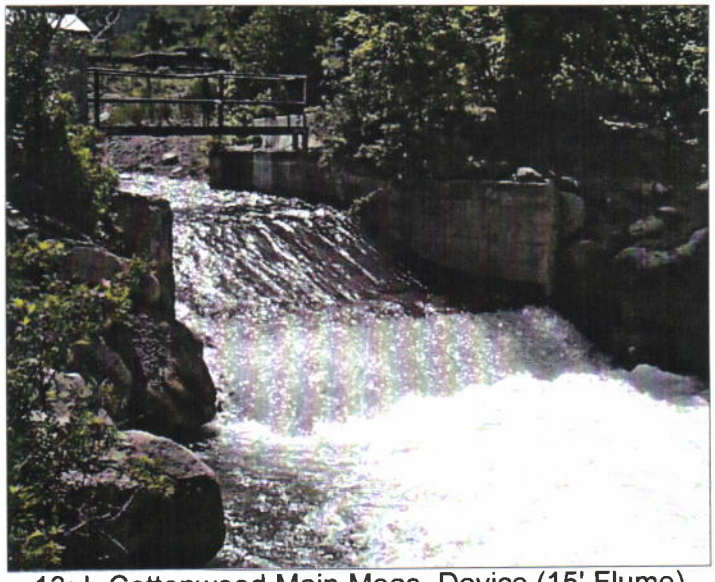

13: L Cottonwood Main Meas. Device (15' Flume)

14: Sandy Ditch Intake

15: Sandy Metro Stream Intake & Radial Gates

16: Sandy Ditch Meas. Device (7' Weir)

17: Cutoff Savings Ditch & Richards - North Telog

18: Cutoff Savings Ditch & Richards - South Telog

LITTLE COTTONWOOD DISTRIBUTION SYSTEM DIVERSIONS (5/25/2001)

19: - Control of Overflow

20: Cutoff Savings Intake

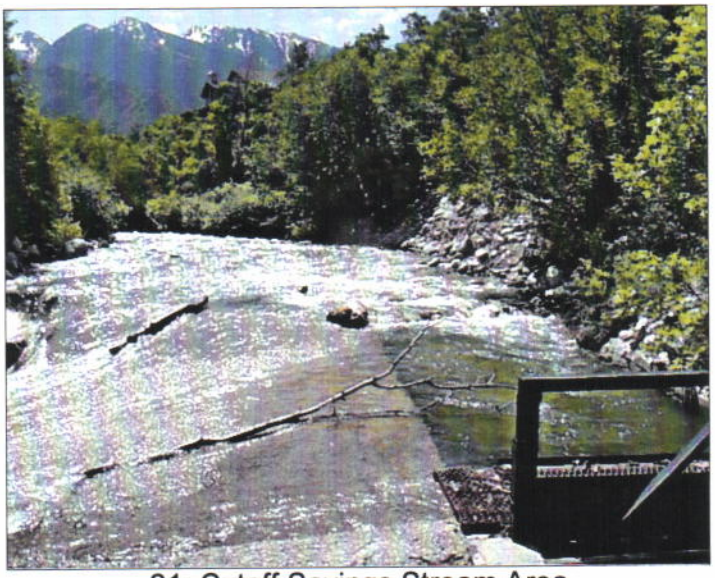

21: Cutoff Savings Stream Area

22: Nickle & Cutoff Savings

23: Nickle & Cutoff Savings

24: Union & East Jordan Surplus

LITTLE COTTONWOOD DISTRIBUTION SYSTEM DIVERSIONS (5/25/2001)

25: Union & East Jordan Surplus

26: L.C. Tanner

27: L.C. Tanner

28: Walker Ditch

29: Brown Ditch