

Problem Areas

All Fire simulations met the required minimum criteria.

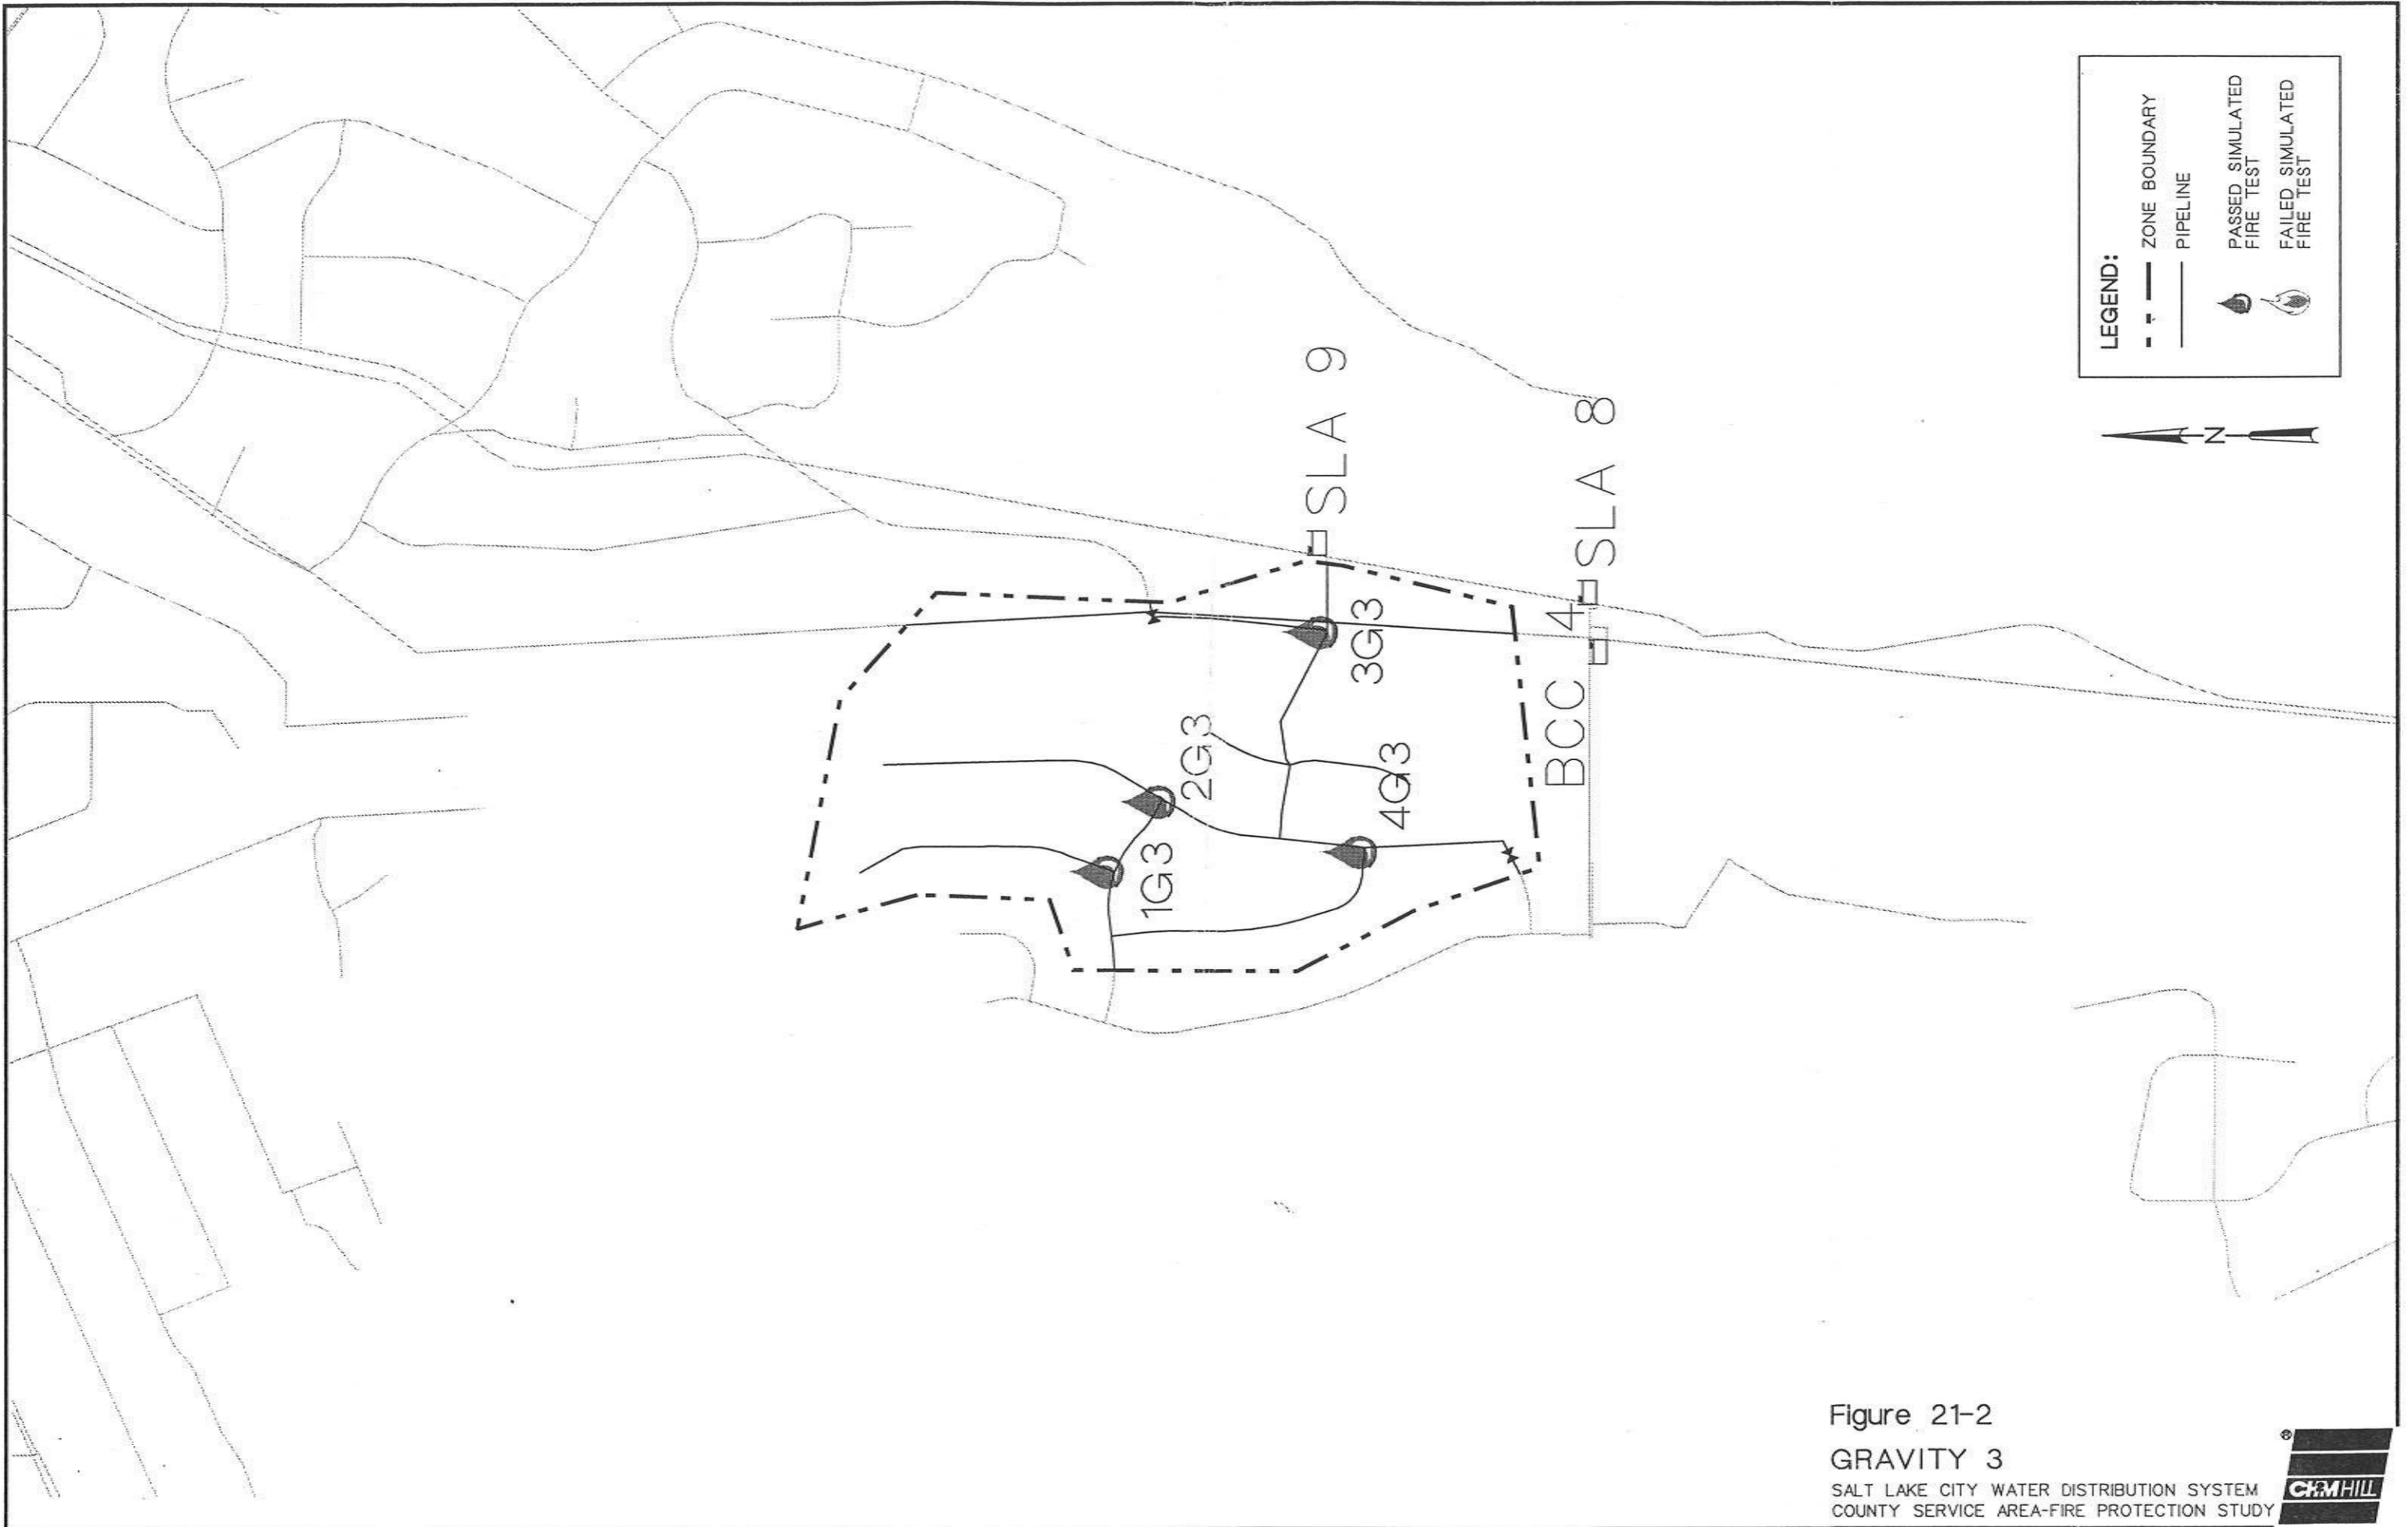


Figure 21-2

GRAVITY 3

SALT LAKE CITY WATER DISTRIBUTION SYSTEM
 COUNTY SERVICE AREA-FIRE PROTECTION STUDY

